



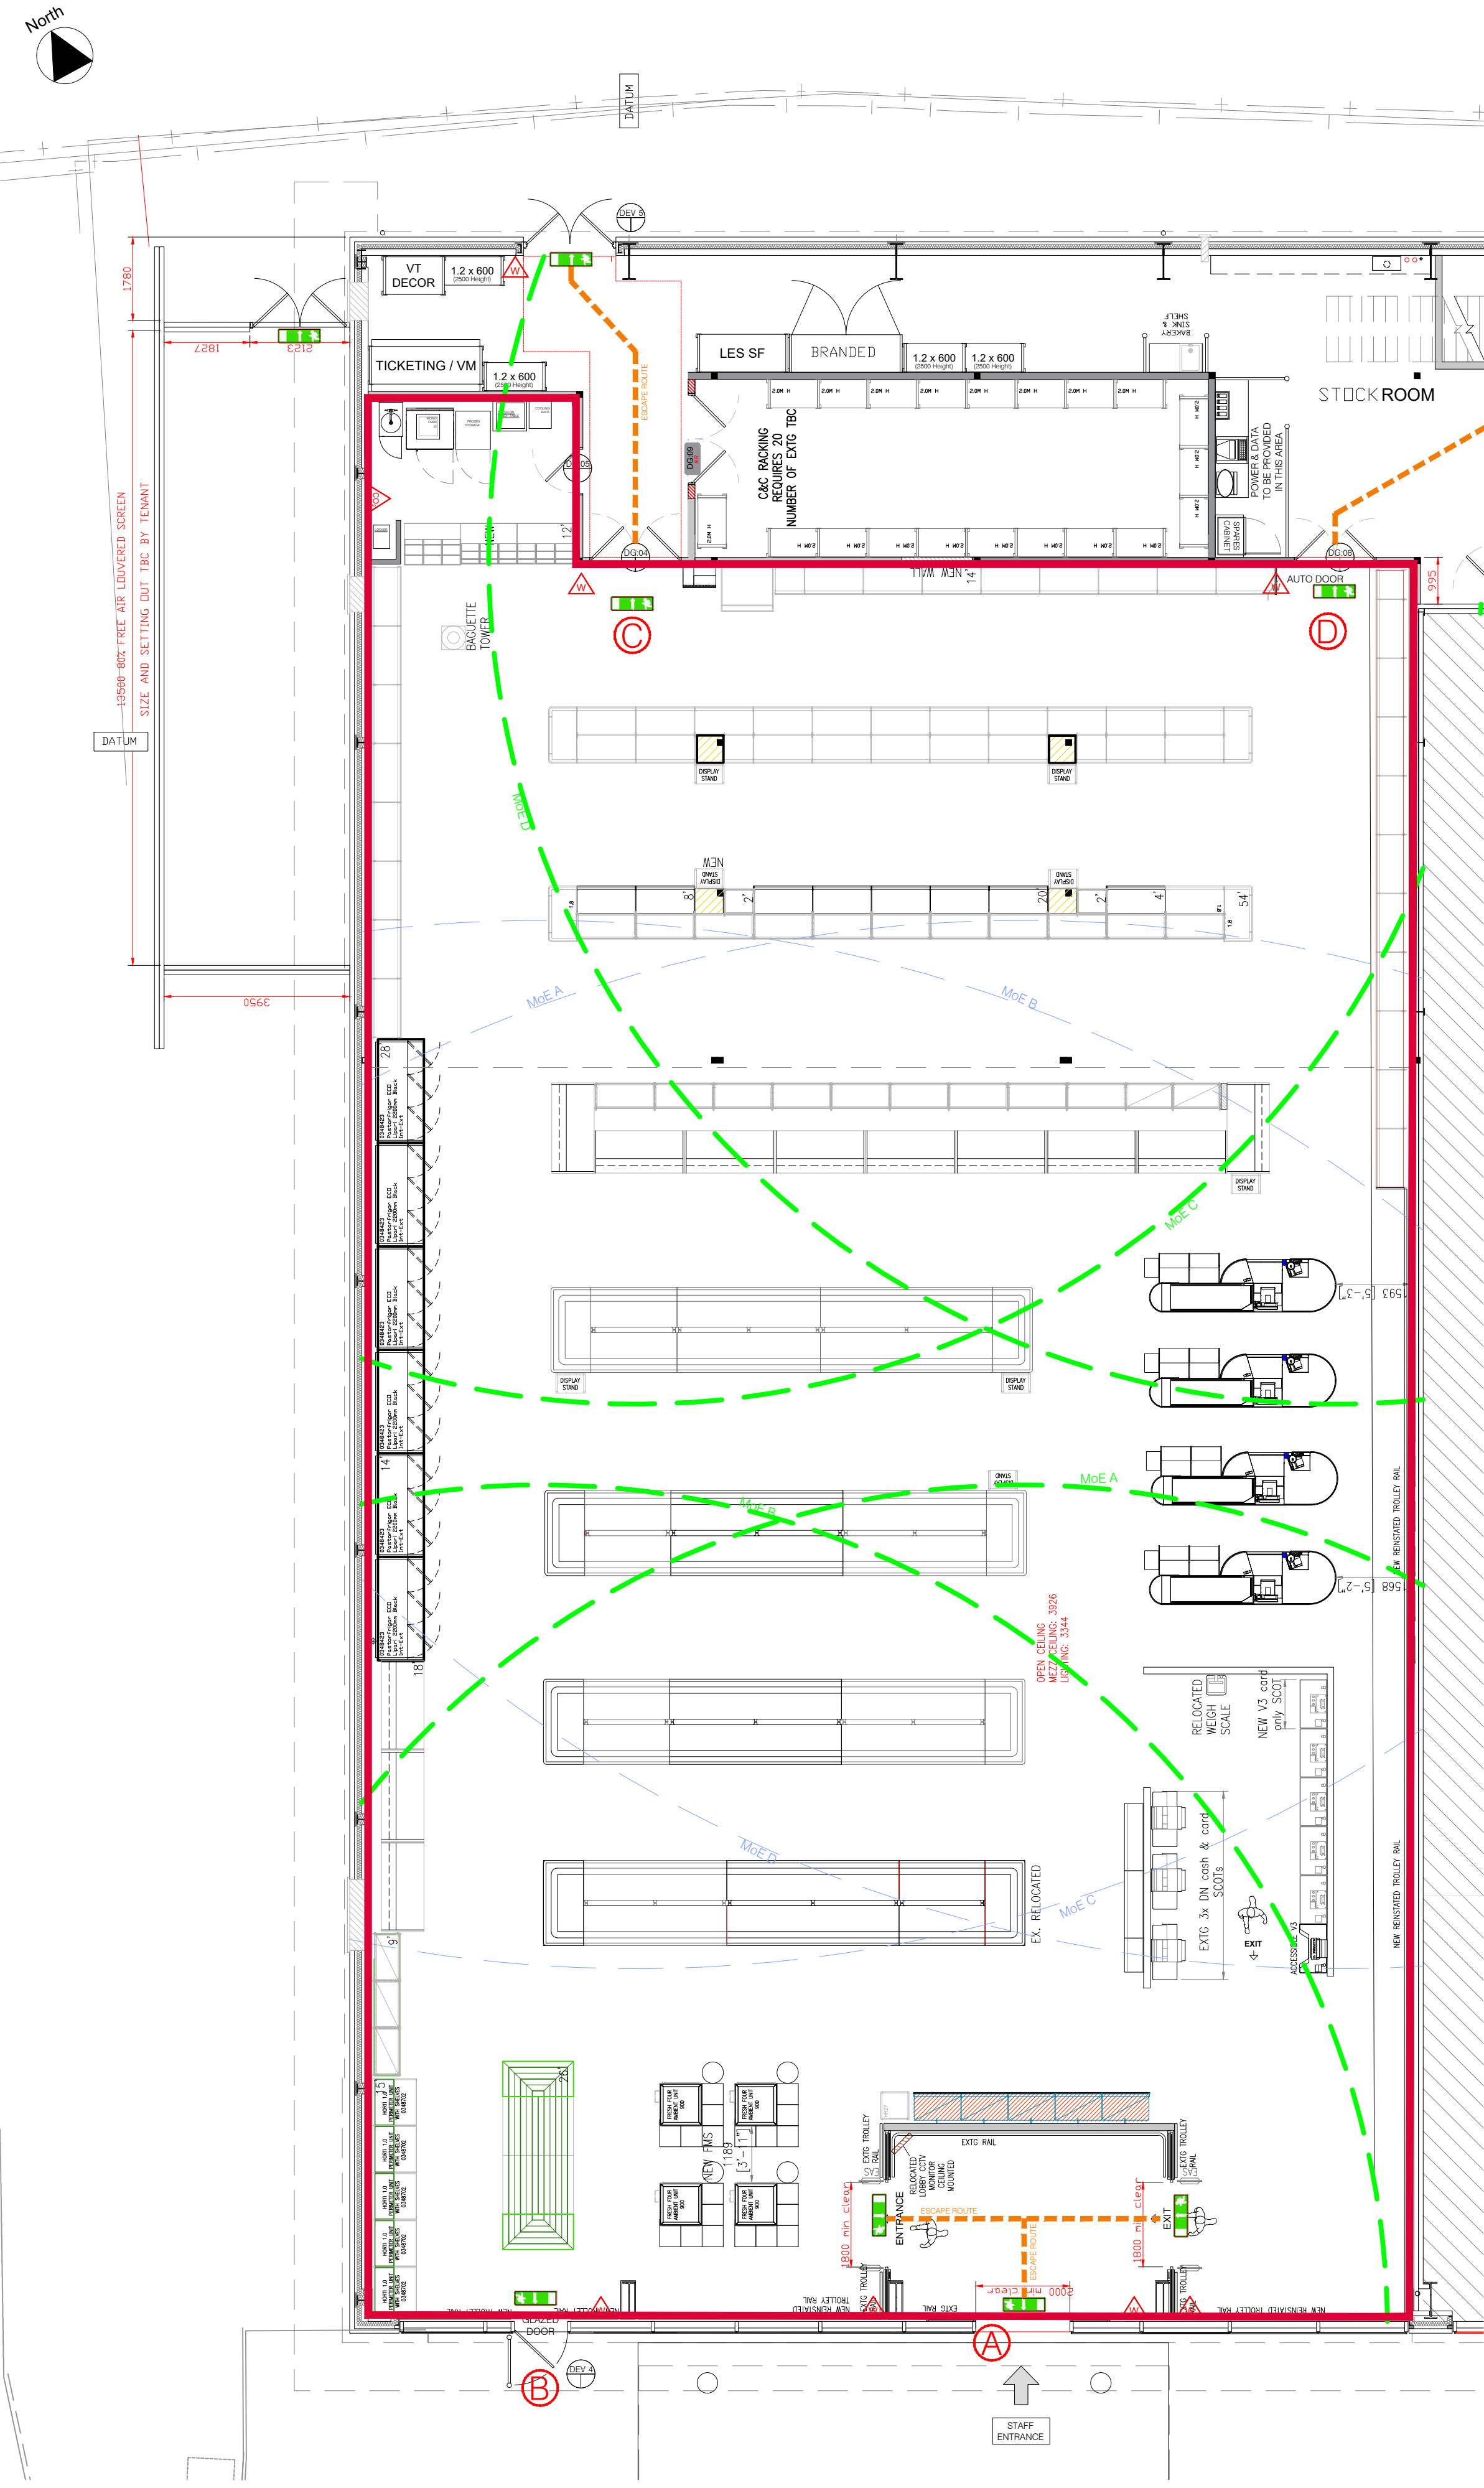

01 GROUND FLOOR PLAN  
1:100

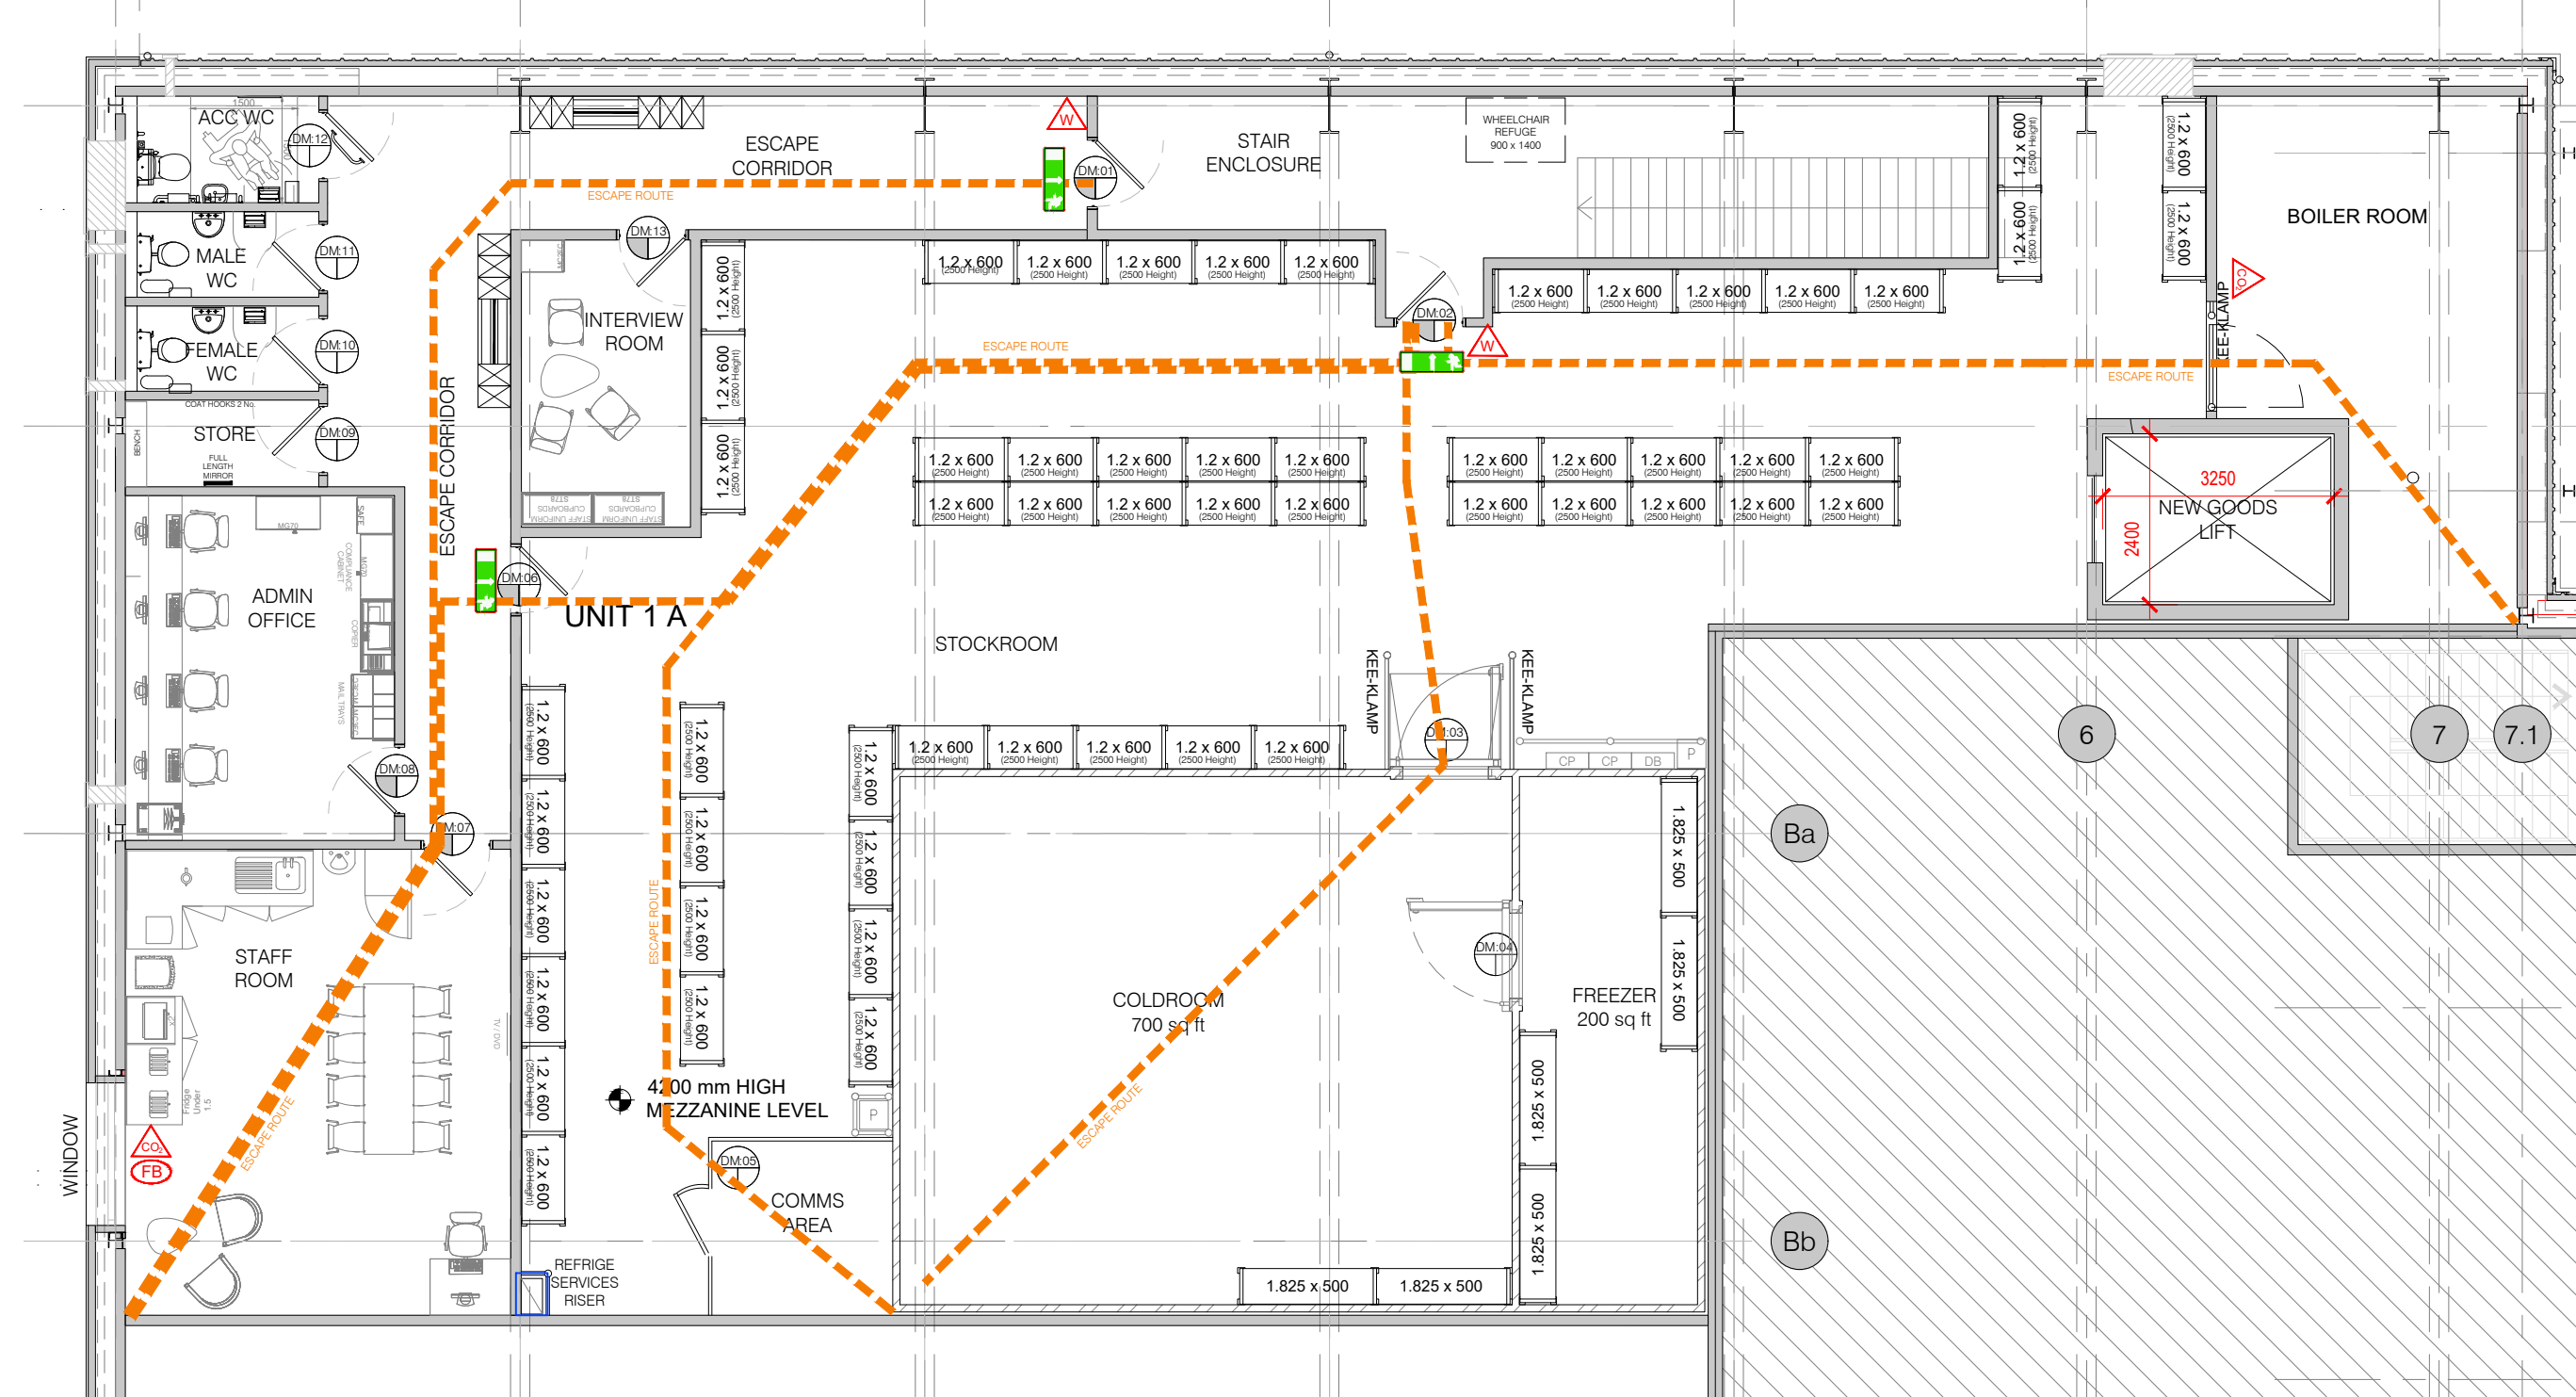

02 MEZZANINE FLOOR PLAN  
1:100

| SAMPLE (Indicatively shown) | PRODUCT CODE | SIGN CODE |
|-----------------------------|--------------|-----------|
|                             | DOUBLE SIDED | -         |
|                             | DOUBLE SIDED | -         |
|                             | DOUBLE SIDED | -         |
|                             | DOUBLE SIDED | -         |
|                             | DOUBLE SIDED | -         |
|                             | DOUBLE SIDED | -         |
|                             | SINGLE SIDED | -         |
|                             | SINGLE SIDED | -         |

NOTES:

- ALL PROPOSED FIRE ESCAPE SIGNAGE TO MEET WITH REQUIREMENTS OF M&S FIRE SAFETY DESIGN STRATEGY V5
- WORKS AND SIGNAGE SHALL COMPLY WITH ISO 7010 AND THE REQUIREMENTS OF HEALTH AND SAFETY (SAFETY SIGNS AND SIGNALS) REGULATIONS 1996. SIGNAGE USED AT THE PERIMETER OF THE STORE SALES FLOOR, AND TO FINAL EXITS BACK OF HOUSE, ARE TO BE ILLUMINATED AND MAINTAINED WITH A ONE HOUR DURATION.
- SIGNAGE USED IN THE CENTRE OF THE SHOP FLOOR IS TO BE NON-ILLUMINATED
- FIRST AID FIRE FIGHTING EQUIPMENT WILL BE IN ACCORDANCE WITH EN 3 AND MAINTAINED IN ACCORDANCE WITH BS 5306-3:2009

LEGEND:

- SD SMOKE DETECTOR
- SD CEILING VOID SMOKE DETECTOR
- HD HEAT DETECTOR
- MC MANUAL CALL POINT (BREAKGLASS)
- XB XENON BEACON
- BL BELL (WHITE)
- BL BELL (RED)
- BA BOMB ALERT KEYSWITCH
- FAP FIRE ALARM PANEL
- CM CONTACT INPUT MODULE
- RM RELAY INTERFACE MODULE
- SN SOUNDER NOTIFICATION MODULE POWER SUPPLY
- FB FIRE BLANKET
- 9L 9L WATER FIRE EXTINGUISHER
- 2kg 2 kg CARBON DIOXIDE FIRE EXTINGUISHER
- 2kg 2 kg DRY POWDER FIRE EXTINGUISHER

MEANS OF ESCAPE:

- INDICATES 18m DIRECT TRAVEL RADIUS
- INDICATES 30m DIRECT TRAVEL RADIUS

DO NOT SCALE FROM THIS DRAWING.  
ALL DIMENSIONS TO BE CHECKED ON SITE.  
COPYRIGHT PROTECTED.

INFORMATION ISSUE

**GREEN STORE ASBESTOS STATEMENT**

This store was constructed Post 2000. The importation, supply and use of asbestos was prohibited on the 24th November 1999. Therefore, asbestos should not have been used on M&S premises and an asbestos survey is not required.  
Recommendation Prior to any Refurbishment Works  
Post 2000 construction does not require an asbestos survey.

**LICENCE DRAWINGS BASED ON ARCHIVE INFORMATION FROM SIMPLE COMPLIANCE.**

**LICENSING KEY**

- Area for sale of alcohol for consumption off the Premises
- Line to show fire strategy route.

**NOTE:** All Sales areas for the sale of alcohol for consumption off the Premises

|     |      |             |       |         |
|-----|------|-------------|-------|---------|
| REV | DATE | DESCRIPTION | DRAWN | CHECKED |
| 00  |      |             |       |         |

LOCATION FIGURE

**M&S**  
EST. 1884

STORE NAME  
**NETHERFIELD NOTTINGHAM**  
COUNTRY  
**ENGLAND**  
PROJECT

DRAWING  
**PROPOSED GROUND AND MEZZANINE FLOOR LICENCE PLANS**

CONSULTANT  
**NJSR CHARTERED ARCHITECTS LLP**  
DISCIPLINE DESCRIPTION  
**ARCHITECTURE**  
CONSULTANT LOGO

**NJSR** **NJSR Chartered Architects LLP**  
SOUTHPORT +44(0) 170 453 1252  
MANCHESTER +44(0) 161 873 8770  
[www.njsr.co.uk](http://www.njsr.co.uk)

| SCALE | PAPER SIZE | DATE     | DRAWN | CHECKED |
|-------|------------|----------|-------|---------|
| 1:100 | A1         | 26.08.25 | AA    |         |

| STORE NUMBER | PROJECT No | DISCIPLINE CODE | DRAWING No |
|--------------|------------|-----------------|------------|
| 1413         | NVC049     | A               | 00230      |

| CONSULTANT PROJECT No | STATUS | REVISION |
|-----------------------|--------|----------|
| 1097-554              | I      | 00       |